


SoC Over Time: P.S. Optimizer vs. Standard Controls on a 1.5MW/1MWh System

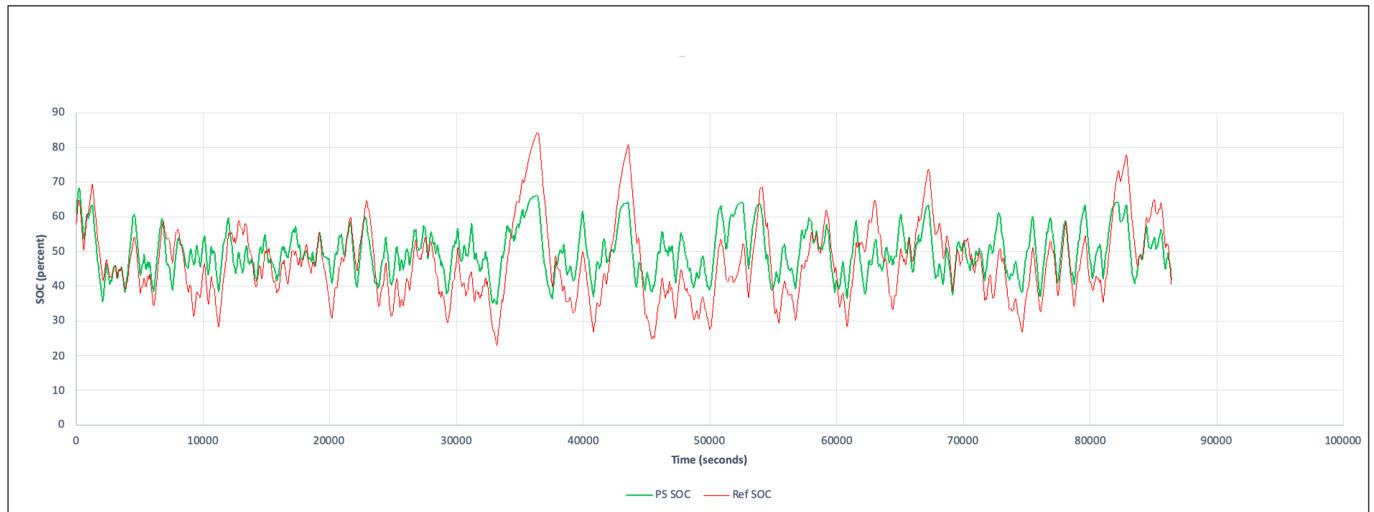

	PS Optimizer	Standard Method
Performance Score	0.938501679	0.925520716
DoD	33.45887978	61.68870624
Average SoC	49.76756418	46.98011678
STD SoC	6.584311521	11.03765976
Max. SoC	68.29808354	84.58741503
Min. SoC	34.83920376	22.89870879
Cycles	10.24402646	10.78348431