


# SoC Over Time: P.S. Optimizer vs. Standard Controls on a 2MW/1MWh System

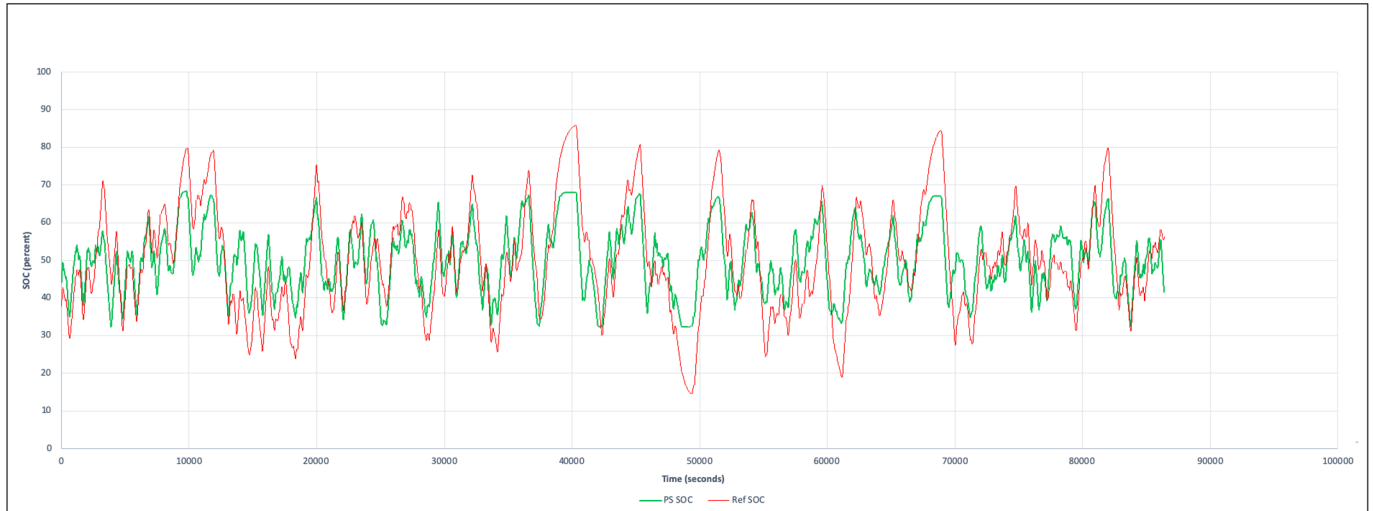

	PS Optimizer	Standard Method
Performance Score	0.94564074	0.932251951
DoD	36.23195726	71.45393
Average SoC	49.88222327	49.84801579
STD SoC	8.708470737	14.01512766
Max. SoC	68.38770773	85.96977775
Min. SoC	32.15575047	14.51584775
Cycles	12.74252399	13.59191999